


# **CROOK COUNTY, WYOMING SMALL WASTEWATER APPLICATION PACKAGE FOR A PERMIT TO CONSTRUCT**

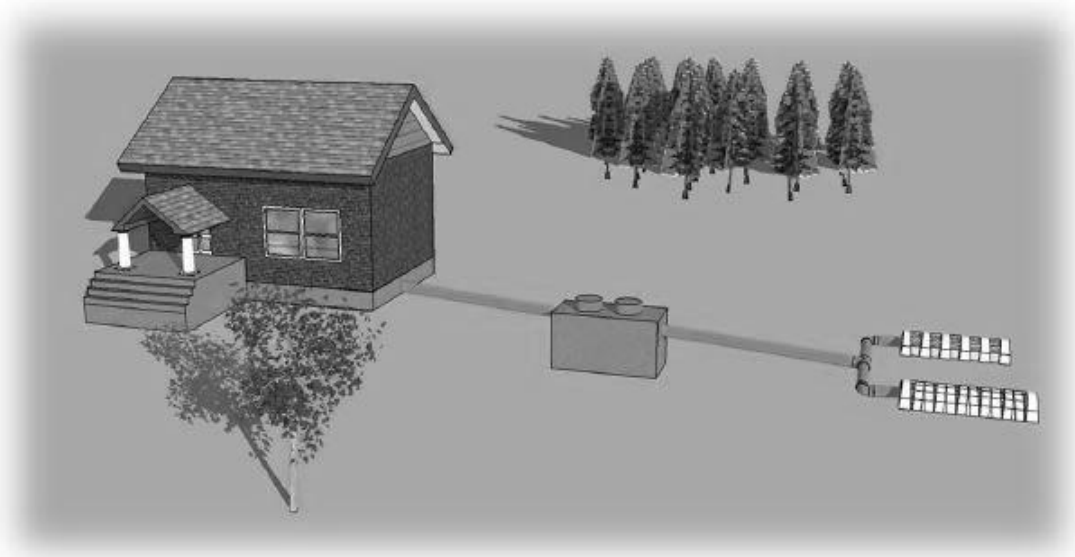

**CROOK COUNTY SMALL WASTEWATER REGULATION**  
Adopted by Resolution: May 1, 2018

**DELEGATION AGREEMENT WYOMING DEPARTMENT OF  
ENVIRONMENTAL QUALITY AND CROOK COUNTY,  
WYOMING**  
Effective May 1, 2019

## Introduction

This application package will assist you with submitting a completed application for a permit to construct a small wastewater treatment and disposal system. Complete and submit 3 copies of only those pages that are applicable to your system. If you complete the required pages using the information in this design package as accurately as possible, your small wastewater permit application should comply with the minimum requirements of the Crook County Small Wastewater Regulation, Adopted by Resolution: May 1, 2018.

This application package is designed for conventional systems (septic tank and leachfield) only. In order to use this package, your system must meet all the following criteria:

1. Wastewater flow of less than 2,000 gallons per day of waste containing domestic sewage.
2. Standard trench or bed type disposal systems, using either stone and perforated pipe or chambers.
3. Seasonal high groundwater, bedrock, or impervious clay layers must be four feet or more below the bottom of the proposed leachfield.
4. Soil percolation rates must be  $\geq 5$  minutes per inch (mpi) and  $\leq 60$  mpi.

If your system does not meet all these requirements, a non-conventional system may be required. Examples of non-conventional systems are mounded or partially mounded systems, non-discharging ponds, or evapotranspiration systems. Since these types of facilities are more difficult to design and construct, this package does NOT provide guidance in the design of non-conventional disposal systems. Please contact the Crook County Growth & Development Administrator if you propose to use a non-conventional system.

For systems exceeding 2,000 gallons per day or for wastewater that is not entirely domestic waste, contact the Underground Injection Control (UIC) Program at 307-777-5623 or refer to: <http://deq.wyoming.gov/wqd/underground-injection-control/>.

This permit application has been prepared under the direction of Ryan McBride, P.E. # 15068, a registered professional engineer employed by the Wyoming Department of Environmental Quality, Water Quality Division. DEQ maintains a signed and sealed copy on file at the DEQ Cheyenne office.

<b>Table of Contents</b>	
Small Wastewater Application for Permit to Construct	Pages 1 - 2
Site Suitability	Page 3
Site Plan Drawing	Page 4
Septic Tank and Piping Worksheet	Page 5
Basic Design Requirements for Septic Tanks	Page 6
Percolation Test Instructions	Page 7
Percolation Test Data Sheet	Page 8
Leachfield Sizing Worksheet	Page 9
Leachfield Design Instructions	Page 10
Table 1. Chamber System Equivalent Areas	Page 11
Perforated Pipe Trench Layout Worksheet	Page 12
Perforated Pipe Trench Layout Design Sheets	Pages 13 - 16
Chambered Trench Layout Worksheet	Page 17
Chambered Trench Layout Design Sheets	Pages 18 - 21
Perforated Pipe Bed Layout Worksheet	Page 22
Perforated Pipe Bed Layout Design Sheet	Page 23
Chambered Bed Layout Worksheet	Page 24
Chambered Bed Layout Design Sheet	Page 25
Attachment 1. Table 2 Excerpted from Crook County Small Wastewater Regulation	Pages 26 - 30

## Crook County Small Wastewater Application for a Permit to Construct

The fee to obtain a Small Wastewater Permit to Construct or As-Built Permit and Inspection is \$200.00. This fee is established by the Crook County Board of County Commissioners and reviewed by the Board from time to time. **The \$200.00 fee shall be submitted with the completed application package.**

<b>Submit completed Application package to:</b>		<b>Date Application and Fee was Submitted</b>	
Crook County Growth & Development Crook County Courthouse 309 E Cleveland Street Sundance, WY 82729 (307)-283-4548 timl@crookcounty.wy.gov		<b>Application/Permit Number</b>	
<b>Or mail completed Application package to:</b>		<b>Authorized for Construction</b>	
Crook County Growth & Development P.O. Box 825 Sundance, WY 82729-0825 (307)-283-4548 timl@crookcounty.wy.gov		Date:	
		By:	
<b>Name of Project:</b>			
<b>Project Description:</b>			
<b>Project Location</b>			
Township:		Range:	
Section:		1/4 1/4 Section:	
Decimal Latitude:		Decimal Longitude:	
Subdivision:		Lot and Block:	
<b>Real Estate Owner</b>		<b>Engineer/Geologist (if applicable)</b>	
<b>Printed Name:</b>		<b>Printed Name:</b>	
<b>Title:</b>		<b>Title:</b>	
Mailing Address:		Mailing Address:	
City, State:	Zip:	City, State:	Zip:
Phone Number:		Phone Number:	
Email:		Email:	
		WY P.E.#	WY P.G.#
<b>Installer Information</b>			
Name:			
Mailing Address:			
City, State, Zip:			
Phone:		Email:	

<b>Property Information</b>		
Physical Address:		
Lot Size:	_____ feet by _____ feet OR _____ acres	
Type of Building:	(single family dwelling, mobile home, commercial, etc.)	
Water Source: (Check One)	<input type="checkbox"/> Cistern	
	<input type="checkbox"/> Private Well	SEO Well Permit Number:
	<input type="checkbox"/> Community Well	Name:
	<input type="checkbox"/> Municipal Well	Name:
Is this a replacement small wastewater treatment facility? If yes, what are you replacing?	<input type="checkbox"/> Yes <input type="checkbox"/> No	Type replaced:
Will this small wastewater treatment facility be located within a delineated source water protection area?	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Does the county approved plat require enhanced septic systems? If yes, do <u>NOT</u> proceed with this application. Contact the Crook County Growth & Development Administrator to discuss other options.	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Provide the legal description of property and evidence of titled ownership by attaching a copy of the sales contract or deed and county approved plat if property is in a platted subdivision.		
<b>Access Route</b>		
As part of this application, the applicant shall certify under penalty of perjury that the applicant has secured and shall maintain permission for Crook County personnel and their invitees to access the permitted site, including (i) permission to access the land where the site is located, (ii) permission to collect resource data as defined by Wyoming Statute § 6-3-414, and (iii) permission to enter and cross all properties necessary to access the site if the site cannot be directly accessed from a public road. A map of the access route(s) to the site shall accompany this application. Attach map as a separate sheet.		
<b>Signatures</b>		
All undersigned certify under penalty of perjury that the owner or applicant has secured and shall maintain permission for Crook County personnel and their invitees to access the permitted site, including (i) permission to access the land where the site is located, (ii) permission to collect resource data as defined by Wyoming Statute § 6-3-414, and (iii) permission to enter and cross all properties necessary to access the site if the site cannot be directly accessed from a public road. All undersigned agree to comply with all applicable Wyoming Statutes and Regulations and to allow the activities described in this application.		
<b>Real Estate Owner (Signature Required)</b>	<b>Engineer/Geologist (if applicable)</b>	
Signature:	Signature:	
Printed Name:	Printed Name:	
Title:	Title:	

## Site Suitability

The owner must be aware of the depth of any impermeable soil layers, high groundwater levels, and slope when considering the septic system location. The septic system must meet the criteria listed in the Application Package Introduction for a conventional system to work properly. **If your site does not meet these criteria, stop filling out this form and contact the Crook County Growth & Development Administrator to discuss other options.** The questions below will ensure you have gathered the information necessary to determine if a conventional septic system is appropriate.


<b>Excavation</b>	Does the soil exploration pit lie within the area of the proposed leachfield?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	Was the bottom of the required soil exploration pit at least <b>4 feet below</b> the bottom of the proposed leachfield, usually a minimum of 7-8 feet total depth? <b><u>This is required.</u></b>		<input type="checkbox"/> Yes <input type="checkbox"/> No
	Take a color photograph of the excavation, showing a tape measure against the sidewall of the trench. Submit a color copy of the photograph as a separate sheet. <b>Photo included in package?</b>		<input type="checkbox"/> Yes <input type="checkbox"/> No
	Depth of the excavation?		
	Who conducted the excavation?		Date:
<b>Impermeable Layers</b>	Did the excavator observe a rock layer below the surface?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	<b>If yes, at what depth below the ground surface?</b>		
	Did the excavator observe a clay layer below the surface?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	<b>If yes, at what depth below the ground surface?</b>		
<b>High Groundwater</b>	Was groundwater present in the excavation?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	<b>If yes, at what depth below the ground surface?</b>		
	Does the soil have an alkali crust at the surface, a rotten egg smell, or a blue-gray or greenish-gray (gley) color that may indicate frequent/continuous saturation?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	<b>If yes, at what depth below the ground surface?</b>		
	Does the soil have a mottled appearance with areas around roots or cracks that look like rust, or is the soil stained a dark red-black or red-brown color, which may indicate periods of saturation?		<input type="checkbox"/> Yes <input type="checkbox"/> No
	<b>If yes, at what depth below the ground surface?</b>		
<b>Slope</b>	What is the estimated slope of the proposed leachfield area? <b>Take a color photograph of the proposed leachfield area and attach a copy as a separate sheet.</b>		
	How far away is the nearest break in slope (the side of a hill or where the slope becomes abruptly steeper) from the proposed leachfield area?		
<b>Other</b>	How far away is the nearest surface water body, such as a lake, river, pond, creek, ditch, or wetland from the proposed leachfield area?		
	How far away are areas where the soil may be compacted by vehicles, such as roads or parking spaces, from the proposed leachfield area?		
	How far away are water supply wells (drinking or irrigation wells), cisterns, or water supply lines from the proposed leachfield area?		
	Do surface drainage features (ditches, depressions, or swales) direct runoff from paved areas such as roofs, patios, or driveways, away from the leachfield?		<input type="checkbox"/> Yes <input type="checkbox"/> No

## Site Plan Drawing

Attach a sketch of your site as a separate sheet, showing each of the items in the table below if applicable.

Check Box If Shown On Site Plan	Element	Required Setback Distance To Septic Tank (feet)	Required Setback Distance To Leachfield (feet)	Is the Setback Distance Satisfied?
<input type="checkbox"/>	Property lines	10	10	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	All buildings, roads, and driveways	—	—	—
<input type="checkbox"/>	Setback to buildings w/out a foundation drain	5	10	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Setback to buildings with a foundation drain	5	25	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Private wells (including neighbors)	50	100	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Public water supply wells	100	200	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Potable water supply lines	25	25	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Surface water (ditch, pond, Intermittent waterways, etc.)	50	50	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Septic tank	—	10	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Break in slope (where slope gets abruptly)	15	15	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Cisterns	25	25	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	Leachfield & Replacement Leachfield	10	—	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/>	North arrow	—	—	—
<input type="checkbox"/>	Slope (arrow pointing downslope)	—	—	—
<input type="checkbox"/>	Location of numbered percolation test holes (numbered)	—	—	—
<input type="checkbox"/>	Location of soil exploration pit	—	—	—
<input type="checkbox"/>	Location of cleanout port(s)	—	—	—

### Example site plan:

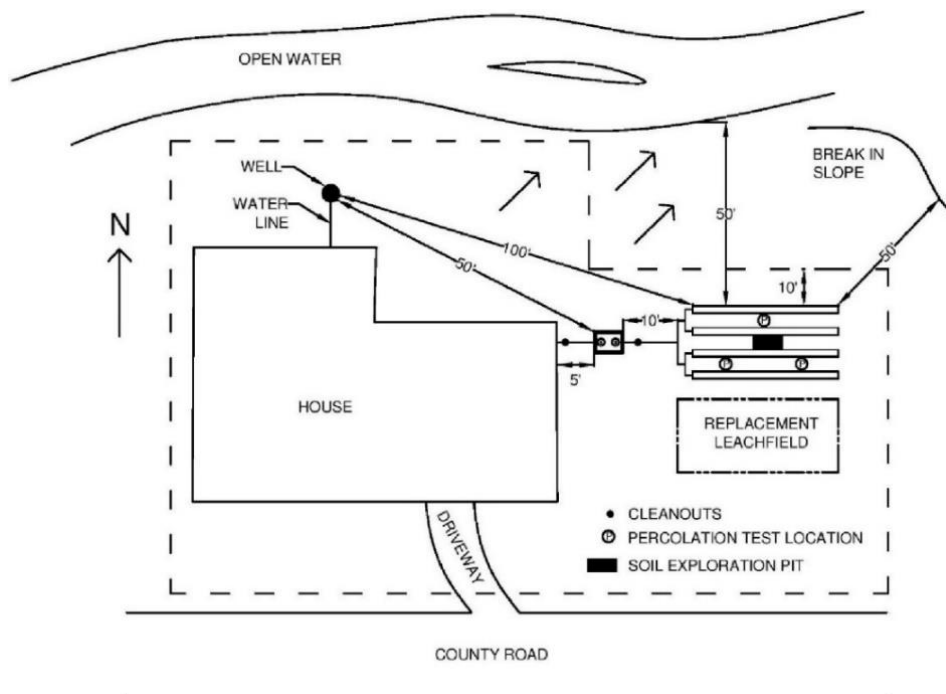


## Septic Tank and Piping Worksheet

Septic Tank	<b>Manufacturer:</b>				
	<b>Model No./Number of Chambers:</b>				
	<b>Size (gallons):</b>				
	<b>Tank Material:</b>		<input type="checkbox"/> Concrete <input type="checkbox"/> Fiberglass <input type="checkbox"/> Thermoplastic <input type="checkbox"/> Other (please describe): _____		
	Is this septic tank on the approved list?			<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Don't Know	
	If no, provide a tank diagram from the manufacturer. If you cannot locate a diagram from the manufacturer, complete the following 3 rows. See Page 8 for septic tank design requirements and a diagram of a septic tank.				
	Please complete for tanks NOT on approved list.	<b>Internal Dimensions:</b> Length (in): _____ Width (in): _____ Height (in): _____			
		<b>Liquid Depth (in):</b>		<b>Amount of Air Space Between Top of Liquid and Chamber Ceiling (in):</b>	
		<b>Operating Capacity</b>	$\left( \frac{\text{Length (in)}}{\text{Length (in)}} * \frac{\text{Width (in)}}{\text{Width (in)}} * \frac{\text{Liquid Depth (in)}}{\text{Liquid Depth (in)}} \right) \div 231 = \frac{\text{Operating Capacity}}{\text{Operating Capacity}} \text{ gallons}$		
	<b>Depth of backfill over tank (minimum of 6" required)</b>				<b>Number of bedrooms, if a residence:</b>
	<b>If more than 4 bedrooms:</b> Does, the tank have additional capacity of 150 gallons per additional bedroom above 1,000 gallons?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Is septic tank installed on a level grade, with firm bedding to prevent settling, and without rock or other obstructions touching the tank as per Crook County Small Wastewater Regulation, Chapter III, Section 6,a,(2)?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Does the tank have a 20-inch access opening in <b>EACH</b> compartment of the tank and a riser from the access opening that terminates at a max of six (6) inches below the ground surface?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Do tank access risers terminating above ground have locking devices?				<input type="checkbox"/> Yes <input type="checkbox"/> No
If installing two tanks in a series, install the downstream tank a minimum of 2 inches lower than the first to insure proper flow. Will the installer use a series of tanks as described?				<input type="checkbox"/> Yes <input type="checkbox"/> No	
Piping	What will the piping material between the house and the septic tank be?		What is the proposed pipe size (diameter)?		
	Will the installer lay the pipe from the house to the septic tank in a straight line?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	If no, will the installer include the <b>required</b> cleanout ports at any alignment change greater than 22.5 degrees?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Will the pipe from the house to the septic tank be more than 100 feet long?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	If yes, will the <b>required</b> cleanout ports be spaced along the line every 100 feet or less?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Crook County recommends a cleanout port facing each direction between the building and the tank. If only one is used, which direction does the <b>required</b> cleanout port face?				<input type="checkbox"/> Toward Bldg. <input type="checkbox"/> Toward Tank
	Will the piping have a minimum slope of ¼ inch per foot (2%)?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	If the installer uses more than one trench, they must use a distribution box or flow divider tee to equalize flow. Will the system include a distribution box or flow divider tee?				<input type="checkbox"/> Yes <input type="checkbox"/> No
	Will the leachfield trenches be less than 100 feet long? <b>This is required.</b>				<input type="checkbox"/> Yes <input type="checkbox"/> No

## Basic Design Requirements for Septic Tanks

1. Tanks must have a minimum of a 1,000-gallon capacity for residences with up to four bedrooms; add 150 gallons of capacity for each additional bedroom.
2. The tank must be watertight, including all joints and connections, and constructed of a durable, non-corrodible material such as concrete, fiberglass, thermoplastic or other approved material. Crook County regulation do not allow steel tanks.
3. The liquid depth shall be between three (3) and six (6) feet deep.
4. A single chamber tank shall have at least a 2:1 length to width ratio or be partitioned to prevent short-circuiting.
5. The first chamber in any two-chambered tank must accommodate at least 50 percent of the capacity.
6. Each chamber must have an access opening with a minimum dimension of 20 inches, from which both inlet and outlet tees shall be accessible.
7. Each chamber must have a cleanout riser that extends to a maximum of six (6) inches below the ground surface.
8. The inlet and outlet tees should be 4-inch diameter, schedule 40 PVC or equivalent, and should extend into undisturbed soil.
9. Install tanks used in a series such that the inlet to each successive tank shall be at least two (2) inches below the outlet of the preceding tank.

**Diagram of a Typical Two-Chambered Septic Tank**

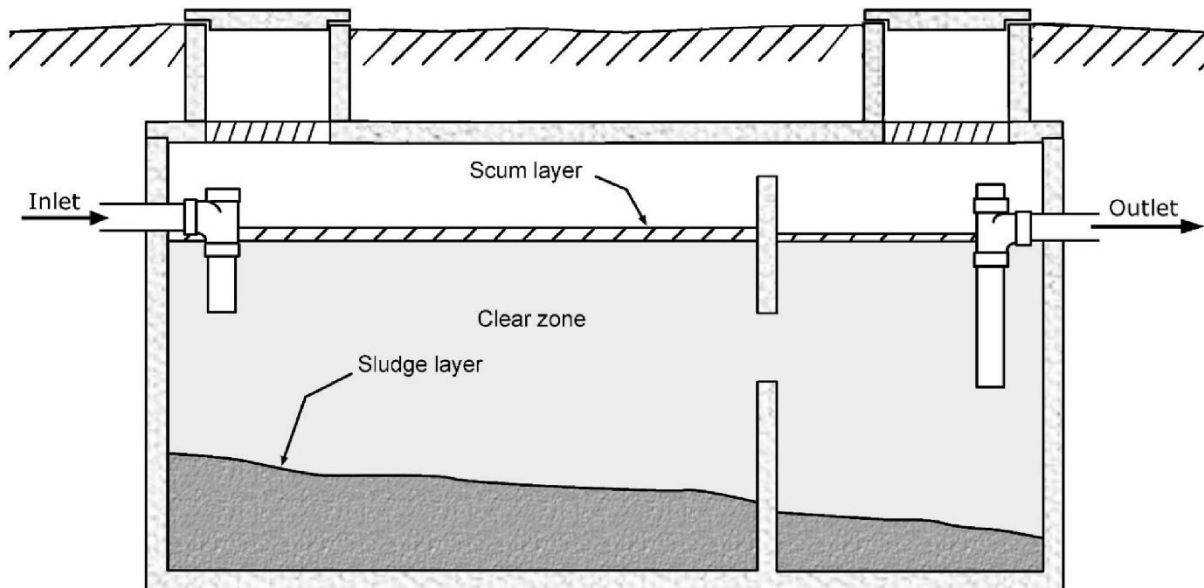

Drawing modified from CIDWT. 2009. *Installation of Wastewater Treatment Systems*. Consortium of Institutes for Decentralized Wastewater Treatment (CIDWT). Iowa State University, Midwest Plan Service. Ames, IA.



## Percolation Test Instructions

In order for a septic system to perform properly, the wastewater must move through the soil at an ideal rate, neither too fast nor too slow. A percolation test estimates the rate at which the water will percolate, or move, through the soil. The information provided by percolation tests is necessary to design leachfields correctly. Follow the steps below to complete a percolation test.

**1. Location of Percolation Test Holes.** The percolation (perc) test holes must be spaced uniformly over the proposed leachfield site. A minimum of three (3) test holes are required, although you can use more if desired.

**2. Test Hole Preparation.** Dig or bore each hole 12 inches wide and as deep as the proposed depth of the leachfield (usually between 30 and 40 inches). Make sure the sides are vertical and scrape the sides and bottom of the hole with a sharp pointed instrument to restore a natural soil surface. Remove loose soil from the hole and place 2 inches of coarse sand, washed gravel, or crushed stone in the bottom in order to prevent scouring or sealing.


**3. Presoaking.** Presoaking is *absolutely* required to get valid percolation test results. Presoaking allows the water conditions in the test hole to reach a stable condition that is similar to a leachfield. Presoaking time varies with soil conditions, but presoak holes for at least 4 hours. Maintain at least 18 inches of water in the test holes for at least 4 hours, then allow the soil to swell for 12 hours (overnight is good) before starting the perc test.

For sandy or loose soils, add 18 inches of water above the gravel or coarse sand. If the 18 inches of water seeps away in 18 minutes or less, add 18 inches of water a second time. If the second filling of 18 inches of water seeps away in 18 minutes or less, the soil is excessively permeable, and the site is unsuitable for a conventional disposal system. If this is the case, contact your county small wastewater permitting authority or the WDEQ district office.

**4. Perc Rate Measurements.** Fill each hole with 12 inches of water and let the soil re-hydrate for 15 minutes prior to taking any measurements. Establish a fixed reference point such as a flat board placed across the top of the hole to measure the incremental water level drop at the constant time intervals. Measure the water level drop to the nearest 1/8 of an inch with a minimum time interval of 10 minutes. Normal time intervals are usually 10 or 15 minutes.

Refill the test hole to 12 inches above the gravel before starting the measurements. Measure down to the water from the fixed reference point. Record this value on the first line in the perc test data sheet (Page 8). Take another measurement after the time interval has elapsed and record on the second line of the table. Calculate the water level drop and record in the table.

Continue the test until the water level drop rate has stabilized, i.e. three consecutive measurements within 1/8 inch of each other. Before the water level drops below 1 inch above the gravel, refill the test hole to 12 inches. Some test holes may take longer to stabilize than others. If the drop rate continues to fluctuate, use the smallest drop rate out of the last six intervals for your calculations.

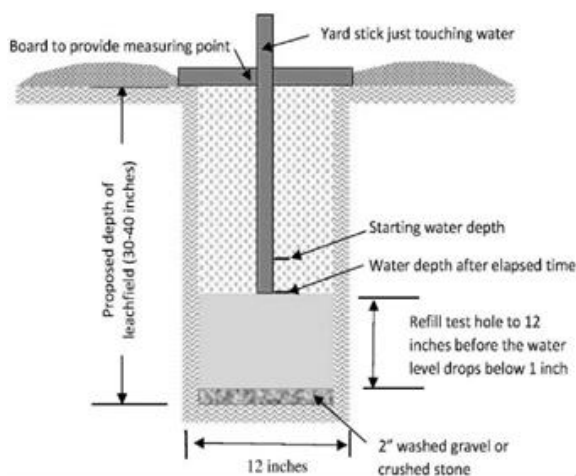

## Percolation Test Data Sheet

Owner/Project Name: \_\_\_\_\_

Date: \_\_\_\_\_

Test holes were pre-soaked for: \_\_\_\_\_ (hours/minutes)

Time Interval: \_\_\_\_\_ min.

**Do not perform percolation test if ground is frozen or if groundwater is present in holes. Holes must be 12 inches in diameter and evenly spaced over the leachfield area. Roughen sides and bottoms of holes and place 2 inches of gravel in each hole.**

		Hole #1 (Required)		Hole #2 (Required)		Hole #3 (Required)		Hole #4 (Optional)		Hole #5 (Optional)		Hole #6 (Optional)	
Depth of Hole:													
Time of Day	Time (Min)	Measure to nearest 1/8 inch		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch	
		Water Level	Drop	Water Level	Drop	Water Level	Drop	Water Level	Drop	Water Level	Drop	Water Level	Drop
			—		—		—		—		—		—
<b>Time Interval (minutes)</b>													
<b>Final Interval Drop (inches)</b>													
<b>Perc Rate (min/inch)</b>													
									<b>Design Perc Rate (min/inch)</b>				

**To calculate drop:** Subtract the water level measurement at the start of your time interval from the water level measurement at the end. The “Drop” is how far the water level went down during the stated time interval. Time intervals must be consistent for each hole throughout the test.

**Leachfield percolation (Perc) rate:** If 3 to 5 holes were tested, use the slowest (highest number) rate of the holes tested. If six or more holes were tested, use the average rate.

**Helpful Conversions:** 1/8 = 0.125    1/4 = 0.25    3/8 = 0.375    1/2 = 0.50    5/8 = 0.625    3/4 = 0.75    7/8 = 0.875

**To calculate perc rate (minutes per inch):** Time Interval (min) ÷ Final Interval Drop (in)

$$\text{Example Perc Rate} = \frac{\text{Time Interval (min.)}}{\text{Final Interval Drop (in.)}} = \frac{10 \text{ min.}}{1\frac{1}{8} \text{ in.}} = 8.9 \frac{\text{min.}}{\text{in.}}$$

I certify that this perc test was done in accordance with the Crook County Small Wastewater Regulation, Appendix A and the instructions on the previous page.

**Test Performed by:** \_\_\_\_\_ **Signature:** \_\_\_\_\_

## Leachfield Sizing Worksheet

<b>Design Flow (gpd)</b>	<b>Please Select Building Type:</b>	<input type="checkbox"/>	<b>Residential Building (Including Mobile Homes)</b>	<p><b>How many bedrooms does the residence have?</b></p> <p>_____ bedrooms</p> <p><b>Does the residence have an unfinished basement?</b></p> <p style="text-align: center;"><input type="checkbox"/> Yes    <input type="checkbox"/> No</p> <p>If yes, add 2 more bedrooms to the number above.</p> <p style="text-align: center;">_____ <b>Total bedrooms</b></p>	<p><b>Enter the number of gallons per day (gpd) of wastewater generated that corresponds with the number of bedrooms in Box 1 below.</b></p> <table style="width: 100%; border: none;"> <tr><td>1 bedroom</td><td style="text-align: right;">150 gpd</td></tr> <tr><td>2 bedrooms</td><td style="text-align: right;">280 gpd</td></tr> <tr><td>3 bedrooms</td><td style="text-align: right;">390 gpd</td></tr> <tr><td>4 bedrooms</td><td style="text-align: right;">470 gpd</td></tr> <tr><td>5 bedrooms</td><td style="text-align: right;">550 gpd</td></tr> <tr><td>6 bedrooms*</td><td style="text-align: right;">630 gpd</td></tr> </table> <p>*Add an additional 80 gallons per day for each bedroom over 6.</p>			1 bedroom	150 gpd	2 bedrooms	280 gpd	3 bedrooms	390 gpd	4 bedrooms	470 gpd	5 bedrooms	550 gpd	6 bedrooms*	630 gpd
	1 bedroom	150 gpd																	
2 bedrooms	280 gpd																		
3 bedrooms	390 gpd																		
4 bedrooms	470 gpd																		
5 bedrooms	550 gpd																		
6 bedrooms*	630 gpd																		
		<input type="checkbox"/>	<b>Non-residential Building</b>	<p>Refer to attached Crook County Small Wastewater Regulation, Table 2. Show calculations and attach a separate sheet if necessary.</p>															
<p><b>Design Flow (gpd):</b> Enter value from cells above or Crook County Small Wastewater Regulation, Table 2 (attached, page 26):</p>				<b>Box 1</b>															
<b>Loading Rate (gpd/ft<sup>2</sup>)</b>	<b>Check Perc Rate Obtained from Perc Test Data Sheet (page 8)</b>		<b>Perc. Rate min/inch</b>	<b>Loading Rate gpd/ft<sup>2</sup></b>	<b>Perc. Rate min/inch</b>	<b>Loading Rate gpd/ft<sup>2</sup></b>	<b>Perc. Rate min/inch</b>	<b>Loading Rate gpd/ft<sup>2</sup></b>											
			<input type="checkbox"/> 5	<b>0.80</b>	<input type="checkbox"/> 16	<b>0.50</b>	<input type="checkbox"/> 30-31	<b>0.39</b>											
			<input type="checkbox"/> 6	<b>0.75</b>	<input type="checkbox"/> 17	<b>0.49</b>	<input type="checkbox"/> 32-33	<b>0.38</b>											
			<input type="checkbox"/> 7	<b>0.71</b>	<input type="checkbox"/> 18	<b>0.48</b>	<input type="checkbox"/> 34-35	<b>0.37</b>											
			<input type="checkbox"/> 8	<b>0.68</b>	<input type="checkbox"/> 19	<b>0.47</b>	<input type="checkbox"/> 36-37	<b>0.36</b>											
			<input type="checkbox"/> 9	<b>0.65</b>	<input type="checkbox"/> 20	<b>0.46</b>	<input type="checkbox"/> 38-40	<b>0.35</b>											
			<input type="checkbox"/> 10	<b>0.62</b>	<input type="checkbox"/> 21	<b>0.45</b>	<input type="checkbox"/> 41-43	<b>0.34</b>											
			<input type="checkbox"/> 11	<b>0.60</b>	<input type="checkbox"/> 22	<b>0.44</b>	<input type="checkbox"/> 44-46	<b>0.33</b>											
			<input type="checkbox"/> 12	<b>0.58</b>	<input type="checkbox"/> 23-24	<b>0.43</b>	<input type="checkbox"/> 47-50	<b>0.32</b>											
			<input type="checkbox"/> 13	<b>0.56</b>	<input type="checkbox"/> 25	<b>0.42</b>	<input type="checkbox"/> 51-55	<b>0.31</b>											
			<input type="checkbox"/> 14	<b>0.54</b>	<input type="checkbox"/> 26 - 27	<b>0.41</b>	<input type="checkbox"/> 56-60	<b>0.30</b>											
			<input type="checkbox"/> 15	<b>0.52</b>	<input type="checkbox"/> 28 - 29	<b>0.40</b>													
<p><b>Loading Rate (gpd/ft<sup>2</sup>):</b> Enter loading rate for your percolation rate from above table.</p>				<b>Box 2</b>															
<b>Leachfield Sizing (ft<sup>2</sup>)</b>	<p><b>Required Leachfield Area (ft<sup>2</sup>)</b> Divide design flow (Box 1) by loading rate (Box 2). Round <b>up</b> to the nearest whole number.</p>		<p style="text-align: right;"><b>Box 3</b></p> $\frac{\text{Design Flow (Box 1)}}{\text{Loading Rate (Box 2)}} = \text{Leachfield Area (Box 3)}$ <p style="text-align: center;">Example: 300 gpd ÷ 0.62 gpd/ft<sup>2</sup> = 483.87 or 484 ft<sup>2</sup></p>																

## Leachfield Design Instructions

Arrange conventional small wastewater (septic system) leachfields using either a trench or a bed layout. Construct either trench or bed layouts using either perforated pipe or open-bottom chamber systems. Crook County prefers trench layouts because they provide more surface area for absorption of wastewater into the soil. Trenches also treat wastewater more efficiently because the undisturbed soil between the trenches allows more oxygen to reach the microbes that break down and treat the wastewater. For this reason, trenches are also more effective when soils have lower or “slower” percolation rates. Use bed layouts where space for a leachfield is limited and only where soils have higher or “faster” percolation rates. Crook County considers trenches spaced less than three (3) feet apart as bed layouts.

To design your leachfield, follow these steps:

1. Choose either a trench or a bed layout.
2. Choose either perforated pipe or open-bottomed chambers for your leachfield.
3. Fill out the layout worksheets that correspond to your selection. These worksheets will determine how many trenches you need or how large to make your bed.
4. Submit **only** the worksheets that you complete.


Trench Leachfield System:	Bed Leachfield System:
Perforated Pipe Trench Layout Worksheets Pages 12 - 16	Perforated Pipe Bed Layout Worksheets Pages 18 - 23
Chambered Trench Layout Worksheets Pages 17 - 21	Chambered Bed Layout Worksheets Pages 24 - 25

Install leachfields to ensure equal distribution of wastewater effluent among all the trenches. Equal distribution allows the use of the entire infiltrative surface of the leachfield and prevents overloading part of the leachfield.

Use either a flow divider tees and piping headers or a distribution box (D-box) to distribute wastewater effluent equally among the trenches of a leachfield. A flow divider tee and piping header system conveys wastewater effluent to each disposal trench using a network of solid piping. Split the discharge line from the septic tank using a flow divider tee (see example below). If there is an odd number of trenches in the leachfield, use a distribution box to divide wastewater effluent evenly among the trenches (see example below). Distribution boxes are typically made of concrete or wastewater-grade plastics and are watertight with a single inlet set at a higher elevation than the outlets. Construct outlets so that their elevations are equal relative to one another.

The maximum length of perforated pipe per trench or per lateral for bed layouts is one hundred (100) feet. The maximum length of chambers per trench or per lateral for bed layouts is fifty (50) feet.

### Examples of Septic Systems Where the Effluent is Distributed Equally.

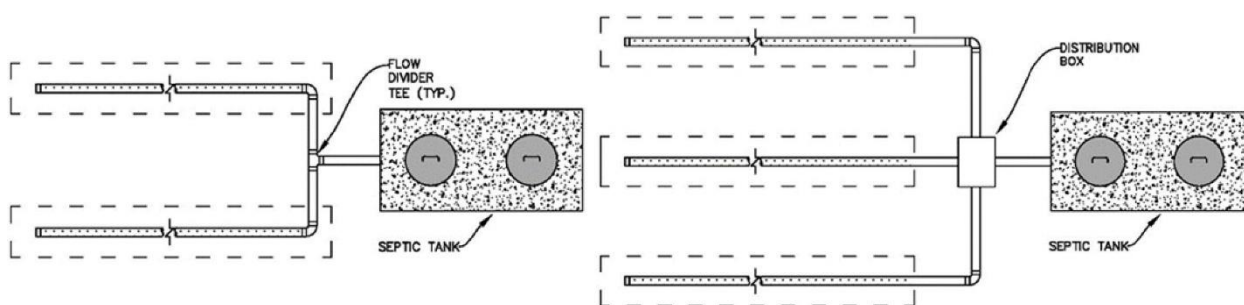

Crook County does not require installation of leachfield trenches in a straight line. In fact, it is always preferable to follow the contour of the land and the bottom of each individual trench shall be level throughout its length. Additionally, never install the leachfield in floodways, at the base of slopes, or in depressions where runoff water could flood the leachfield. Construct leachfields in areas with good surface drainage, where the water cannot pond over the leachfield.

**Table 1. Chamber System Equivalent Areas**

The Crook County Small Wastewater Regulation, Chapter III, Section 4,b,(2),(a) allows for a 30% reduction in the leachfield area when using chambers in place of traditional perforated pipe and stone systems. To calculate the reduction in square footage required to achieve the same amount of infiltrative surface as pipe trenches or beds, use the dimensions provided by the chamber manufacturer. In a trench configuration, the equivalent area is equal to Length \* [(Chamber Width \* 1.43) + (2 \* Effective Sidewall Height)]. In a bed configuration the sidewall is not counted, so the equivalent area is equal to Length \* (Chamber Width \* 1.43). Use dimensions provided in the table below to design leachfields utilizing chamber technology on pages 17 - 21 (chambered trenches) or 24 - 25 (chambered beds) of this application package.

Chamber Class	Chamber Name	Nominal Dimensions			Effective Dimensions			Equivalent Area	
		Length (ft)	Width (in)	Height (in)	Length (ft)	Width <sup>1</sup> (in)	Height <sup>2</sup> (in)	Trench Layout (sf/unit)	Bed Layout (sf/unit)
High Capacity	<b>Quick4 High Capacity</b>	4.4	34	16	4.0	34	11.5	<b>23.9</b>	<b>16.2</b>
	<b>Quick4 Plus High Capacity</b>	4.4	34	14	4.0	34	8.0	<b>21.5</b>	<b>16.2</b>
	<b>Arc 36 High Capacity</b>	5.3	34	16	5.0	34	10.5	<b>29.0</b>	<b>20.3</b>
	<b>BioDiffuser 16" High Capacity</b>	6.3	34	16	6.2	34	11.2	<b>36.7</b>	<b>25.1</b>
Standard	<b>Quick4 Standard</b>	4.4	34	12	4.0	34	8.0	<b>21.5</b>	<b>16.2</b>
	<b>Quick4 Plus Standard</b>	4.4	34	12	4.0	34	8.0	<b>21.5</b>	<b>16.2</b>
	<b>Arc 36</b>	5.3	34	13	5.0	34	7.0	<b>26.1</b>	<b>20.3</b>
	<b>BioDiffuser 11" Standard</b>	6.3	34	11	6.2	34	5.8	<b>31.1</b>	<b>25.1</b>
Standard Low Profile	<b>Quick4 Plus Standard LP</b>	4.4	34	8	4.0	34	3.3	<b>18.4</b>	<b>16.2</b>
	<b>Arc 36 LP</b>	5.3	34	8	5.0	34	3.8	<b>23.4</b>	<b>20.3</b>
Narrow	<b>Quick4 Equalizer 36</b>	4.4	22	12	4.0	22	6.0	<b>14.5</b>	<b>10.5</b>
	<b>Arc 24</b>	5.6	22	12	5.0	22	6.3	<b>18.3</b>	<b>13.1</b>
	<b>BioDiffuser Bio 3</b>	7.3	22	12	7.2	22	6.4	<b>26.5</b>	<b>18.9</b>
Narrow LP	<b>Quick4 Plus Equalizer 36 LP</b>	4.4	22	8	4.0	22	3.3	<b>12.7</b>	<b>10.5</b>
Ultra-Narrow	<b>Quick4 Equalizer 24</b>	4.4	16	12	4.0	16	6.0	<b>11.6</b>	<b>7.6</b>
	<b>Arc 18</b>	5.6	16	12	5.0	16	6.3	<b>14.7</b>	<b>9.5</b>
	<b>BioDiffuser Bio 2</b>	7.3	16	12	7.2	16	6.4	<b>21.3</b>	<b>13.7</b>
Ultra-Narrow LP	<b>Quick4 Equalizer 24 LP</b>	4.4	16	8	4.0	16	2.0	<b>9.0</b>	<b>7.6</b>

<sup>1</sup>The equivalent areas calculation used the outside width of the chamber.



<sup>2</sup>The effective height is the height of the slotted sidewall of the chamber or depth below the flow line of the inlet pipe, whichever is less.

## Perforated Pipe Trench Layout Worksheet

<b>Design</b>				
Required Leachfield Area (Page 9, Box 3)				Box 1
Depth of Trench Below Pipe (ft)				Box 2
Width of Trench (ft)				Box 3
Absorptive Area Per Linear Foot of Trench (ft <sup>2</sup> /ft)	$\frac{\text{Trench Depth (Box 2)}}{\text{Trench Depth (Box 2)}} + \frac{\text{Trench Depth (Box 2)}}{\text{Trench Depth (Box 2)}} + \frac{\text{Trench Width (Box 3)}}{\text{Trench Width (Box 3)}} = \frac{\text{Absorptive Area}}{\text{Absorptive Area}}$			Box 4
Total Trench Length (ft)	$\frac{\text{Required Leachfield Area (Box 1)}}{\text{Absorptive Area (Box 4)}} = \frac{\text{Total Trench Length}}{\text{Total Trench Length}}$			Box 5
<b>Trench Layout</b>				
Number of Trenches to Use	<b>Total Trench Length (ft) (from Box 5)</b>	<b>Minimum Number of Trenches to Use</b>	<div style="text-align: right;">Box 6</div> <b>Number of Trenches to Use = _____</b>  <b>Length of Trenches = _____</b>  A maximum of 100 feet of perforated pipe per trench.  *A distribution box, or D-box, is required when an odd number of trenches is used.	
<b>Notes:</b>	The bottom of each trench shall be level throughout its length. The maximum depth of each trench shall be 5 feet (60 inches). Leachfield header piping shall not be perforated.			
<b>Perforated Pipe Trench Layout Design Sheets</b>				
Select your Trench Layout and complete the following layout design sheet by filling in the boxes with the actual dimensions for your selected trench layout.	<input type="checkbox"/> One Trench Perforated Pipe Layout	Page 13		
	<input type="checkbox"/> Two Trench Perforated Pipe Layout	Page 14		
	<input type="checkbox"/> Three, Five or Multi Trench Perforated Pipe Layout	Page 15		
	<input type="checkbox"/> Four Trench Perforated Pipe Layout	Page 16		



# One Trench Perforated Pipe Layout Design Sheet

**Notes:** Please provide the actual dimensions in the boxes on the diagrams below.  
 \* The bottom of each trench shall be level throughout its length.  
 \* The maximum depth of each trench shall be 5 feet (60 inches).

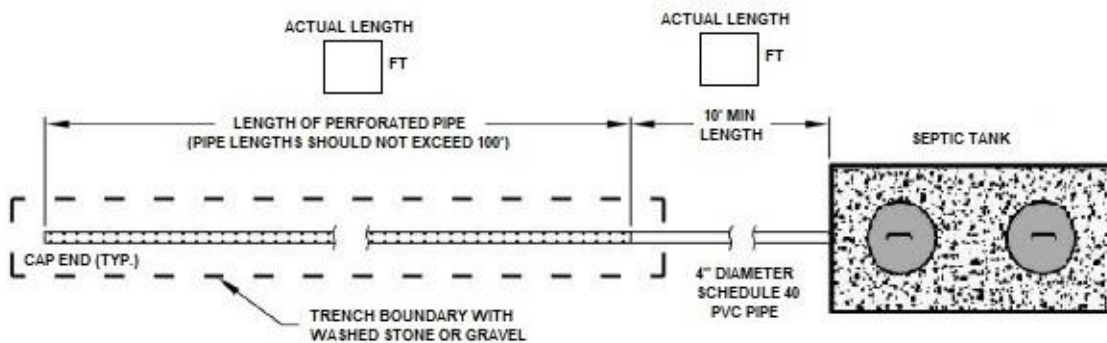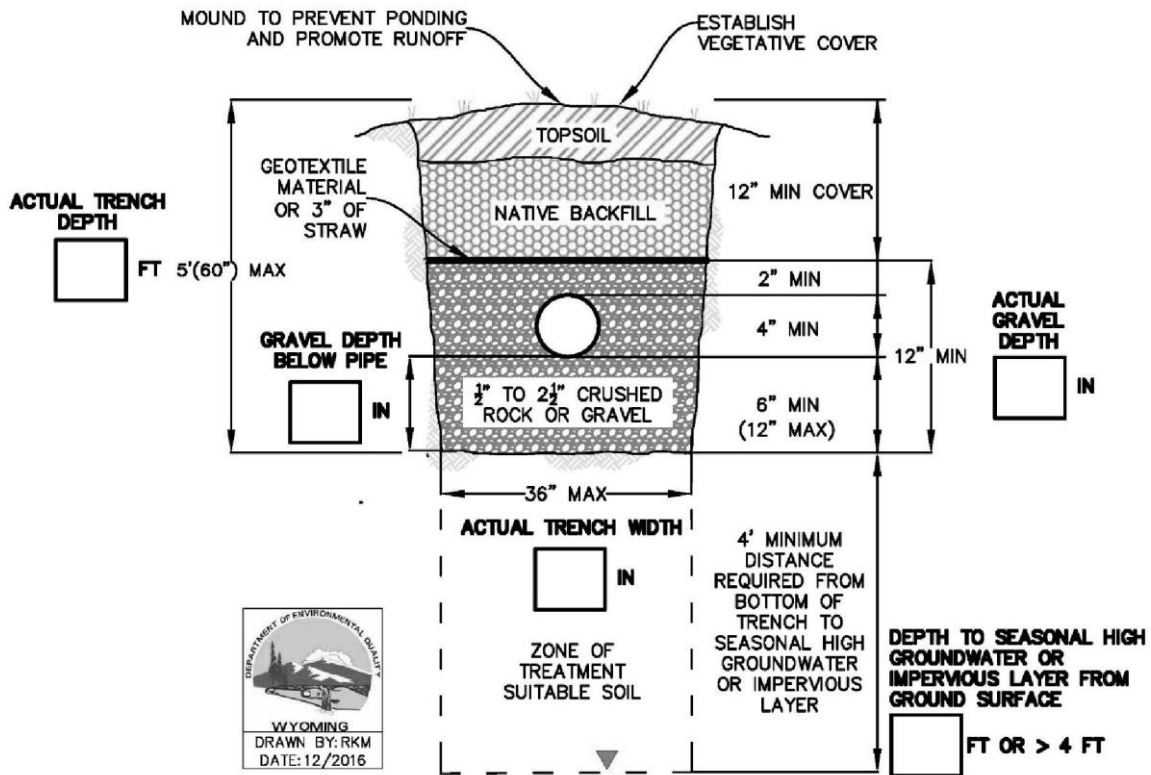

## Two Trench Perforated Pipe Layout Design Sheet

<b>Notes:</b>	Please provide the actual dimensions in the boxes on the diagrams below. * The bottom of each trench shall be level throughout its length. * The maximum depth of each trench shall be 5 feet (60 inches). * Leachfield header piping shall not be perforated.
---------------	---

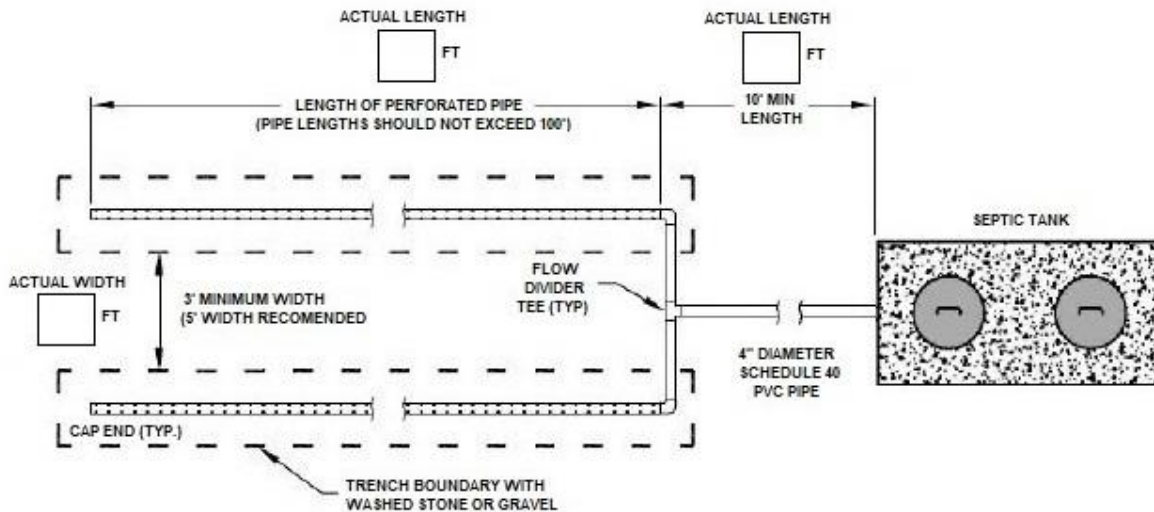
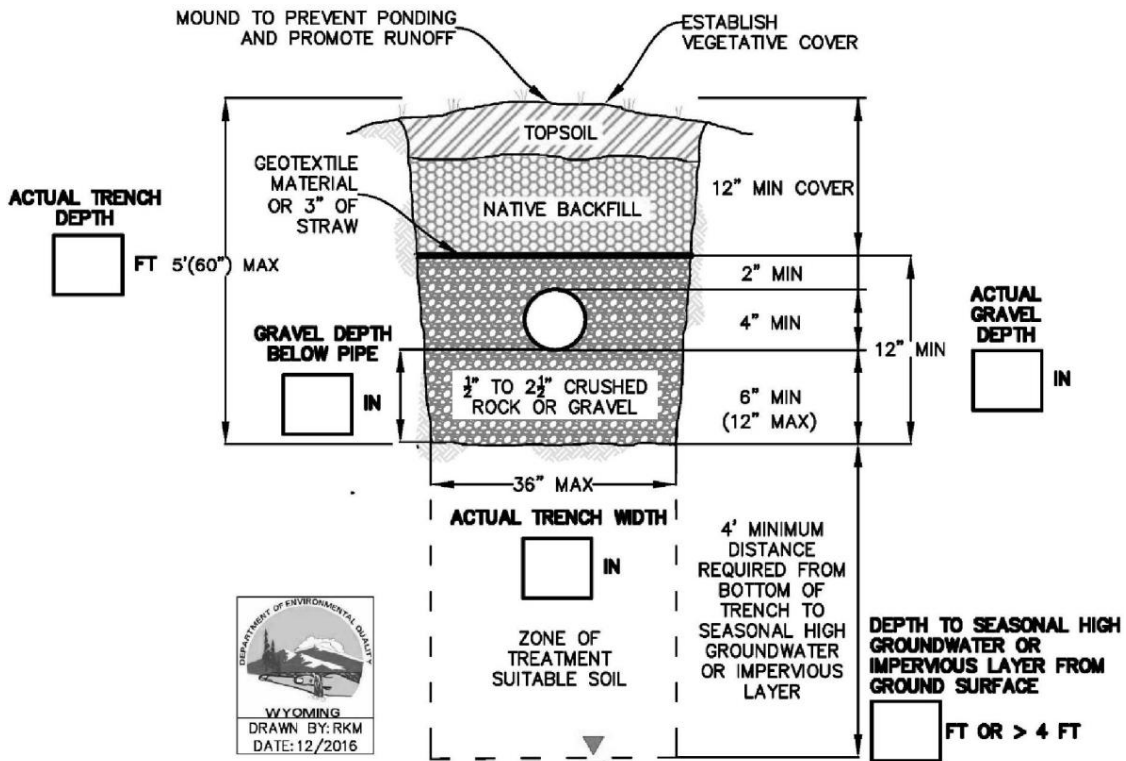




## Three, Five or Multi Trench Perforated Pipe Layout Design Sheet



**Notes:**

- Please provide the actual dimensions in the boxes on the diagrams below.
- \* The bottom of each trench shall be level throughout its length.
- \* The maximum depth of each trench shall be 5 feet (60 inches).
- \* Leachfield header piping shall not be perforated.

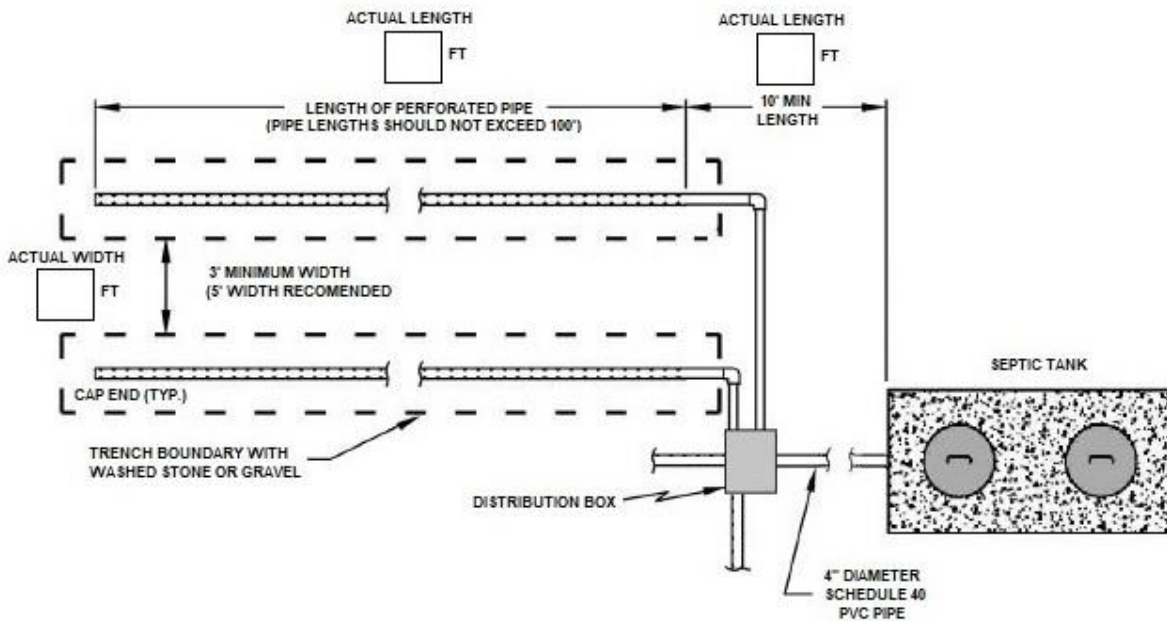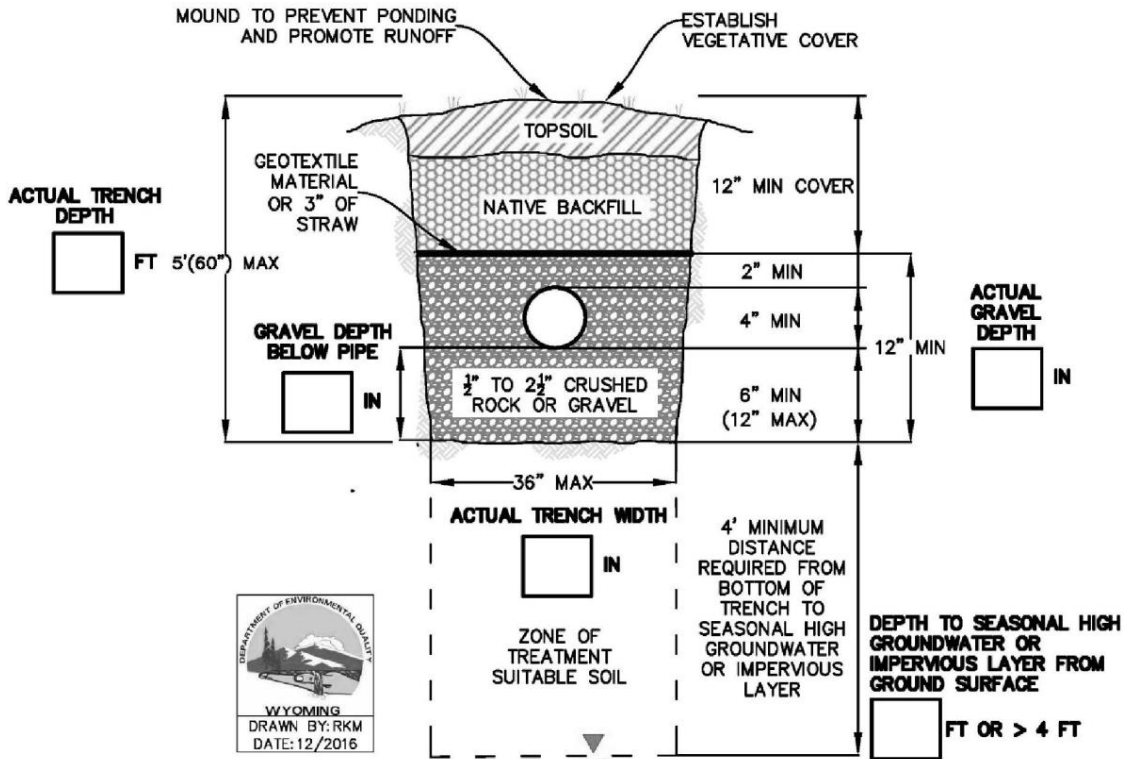

## Four Trench Perforated Pipe Layout Design Sheet

<b>Notes:</b>	Please provide the actual dimensions in the boxes on the diagrams below. * The bottom of each trench shall be level throughout its length. * The maximum depth of each trench shall be 5 feet (60 inches). * Leachfield header piping shall not be perforated.
---------------	---

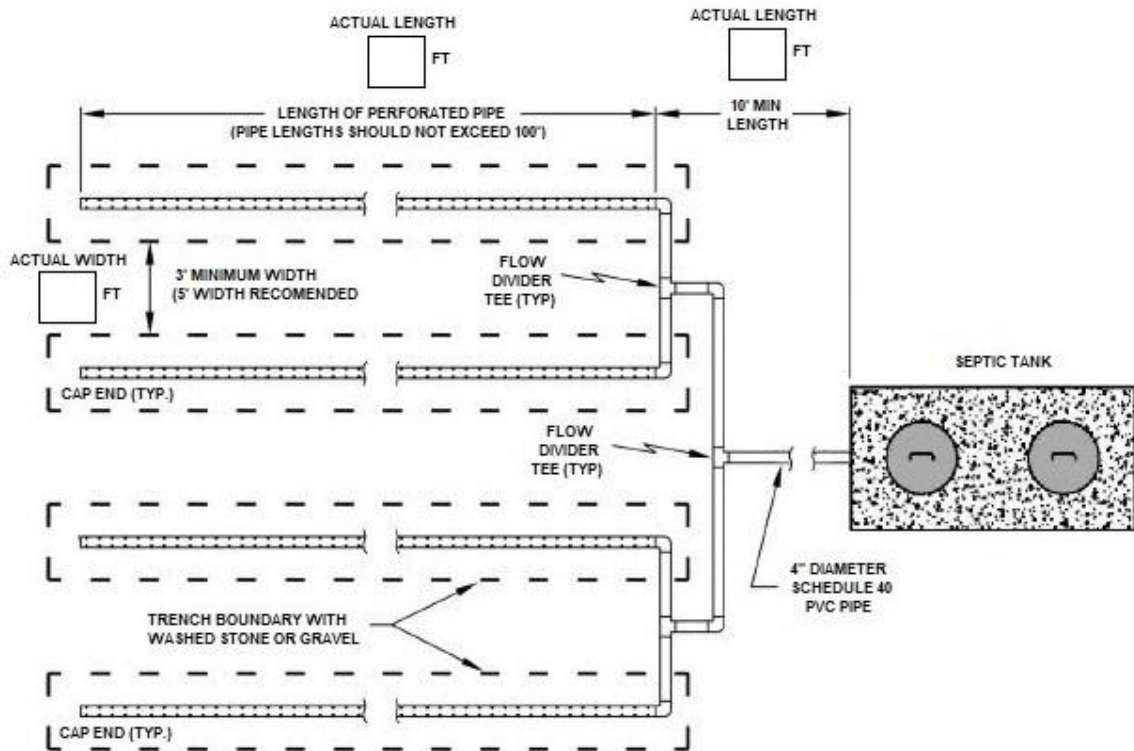
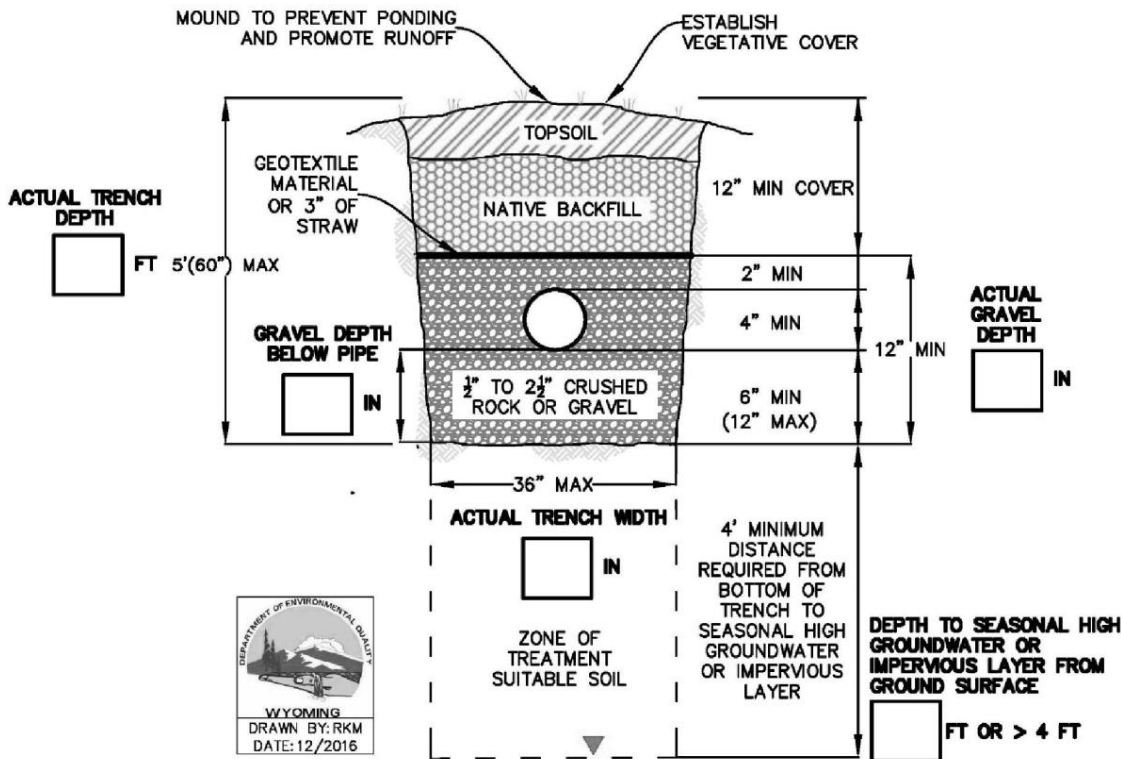


## Chambered Trench Layout Worksheet

Chambers (See Table 1, Page 11)			
Manufacturer			
Model			
Nominal Length (ft)			
Nominal Width (in)			
Nominal Height (in)			
Effective Length (ft)	Box 1		
Design			
Required Leachfield Area (Page 9, Box 3)	Box 2		
Equivalent Area Per Unit (See Table 1, Page 11)	Box 3		
Number of Chambers	Box 4		
	$\frac{\text{Required Leachfield Area (Box 2)}}{\text{Equivalent Area Per Unit (Box 3)}} = \text{Number of Chambers (Round Up)}$		
Trench Layout			
Total Trench Length (ft)	Box 5		
	$\frac{\text{Number of Chambers (Box 4)}}{\text{Effective Length (Box 1)}} = \text{Total Trench Length}$		
Number of Trenches to Use	<b>Total Trench Length (ft) (from Box 5)</b>  <51 51-100 101-150 151-200 201-250 251-300	<b>Minimum Number of Trenches to Use</b>  1 2 3* 4 5* 6	Box 6  <b>Number of Trenches to Use = _____</b>  <b>Length of Trenches = _____</b>  A maximum of 50 feet of chambers per trench.  *A distribution box, or D-box, is required when an odd number of trenches is used.
<b>Notes:</b>	The bottom of each trench shall be level throughout its length. The maximum depth of each trench shall be 5 feet (60 inches).		
Chambered Trench Layout Design Sheets			
Select your Trench Layout and complete the following layout design sheet by filling in the boxes with the actual dimensions for your selected trench layout.	<input type="checkbox"/> One Trench Chambered Layout	Page 18	
	<input type="checkbox"/> Two Trench Chambered Layout	Page 19	
	<input type="checkbox"/> Three, Five or Multi Trench Chambered Layout	Page 20	
	<input type="checkbox"/> Four Trench Chambered Layout	Page 21	



# One Trench Chambered Layout Design Sheet

**Notes:** Please provide the actual dimensions in the boxes on the diagrams below.  
 \* The bottom of each trench shall be level throughout its length.  
 \* The maximum depth of each trench shall be 5 feet (60 inches).

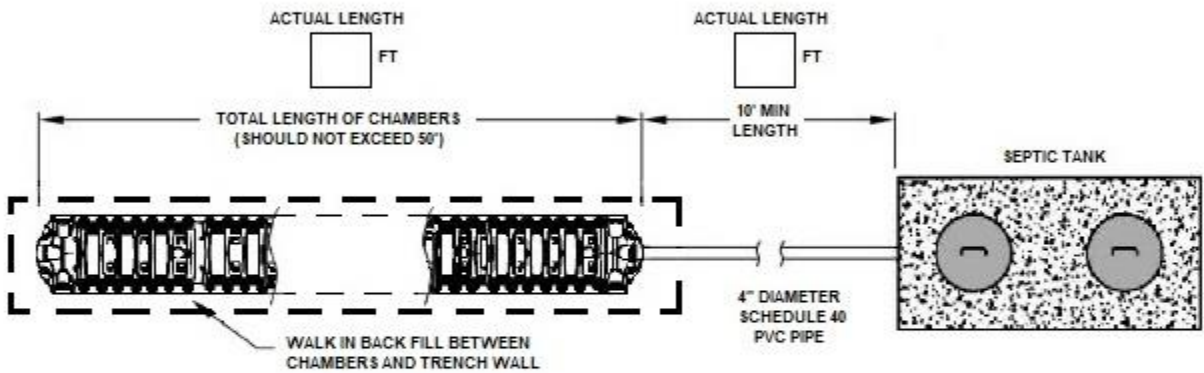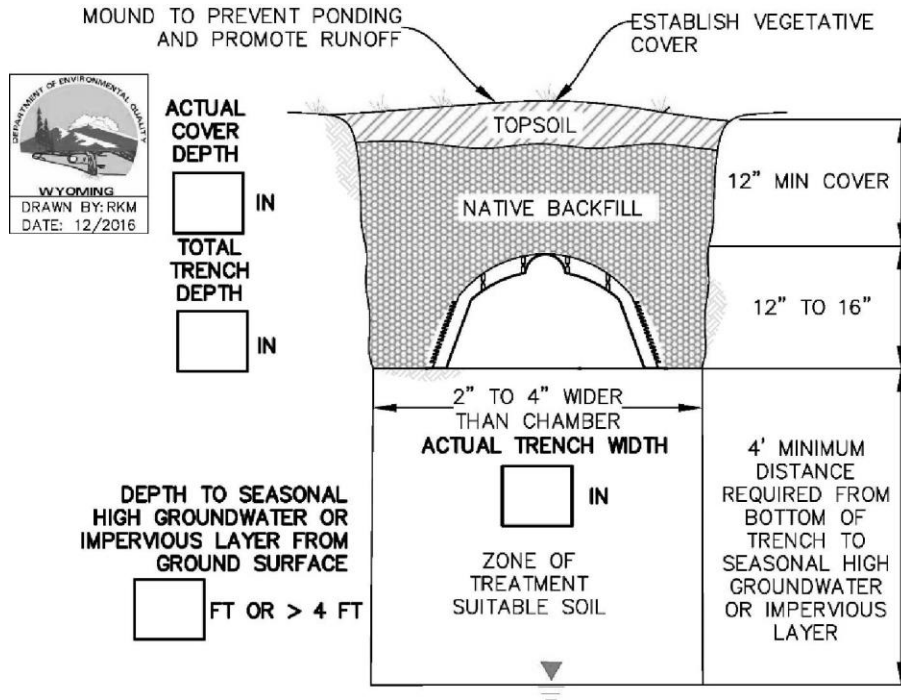

## Two Trench Chambered Layout Design Sheet



<b>Notes:</b>	Please provide the actual dimensions in the boxes on the diagrams below. * The bottom of each trench shall be level throughout its length. * The maximum depth of each trench shall be 5 feet (60 inches).
---------------	--

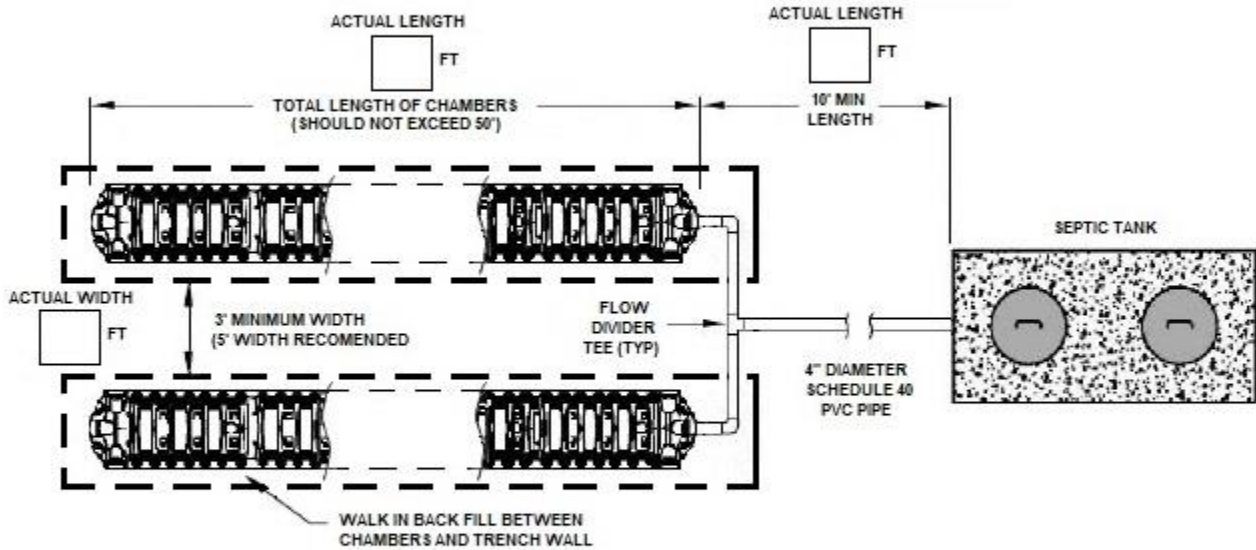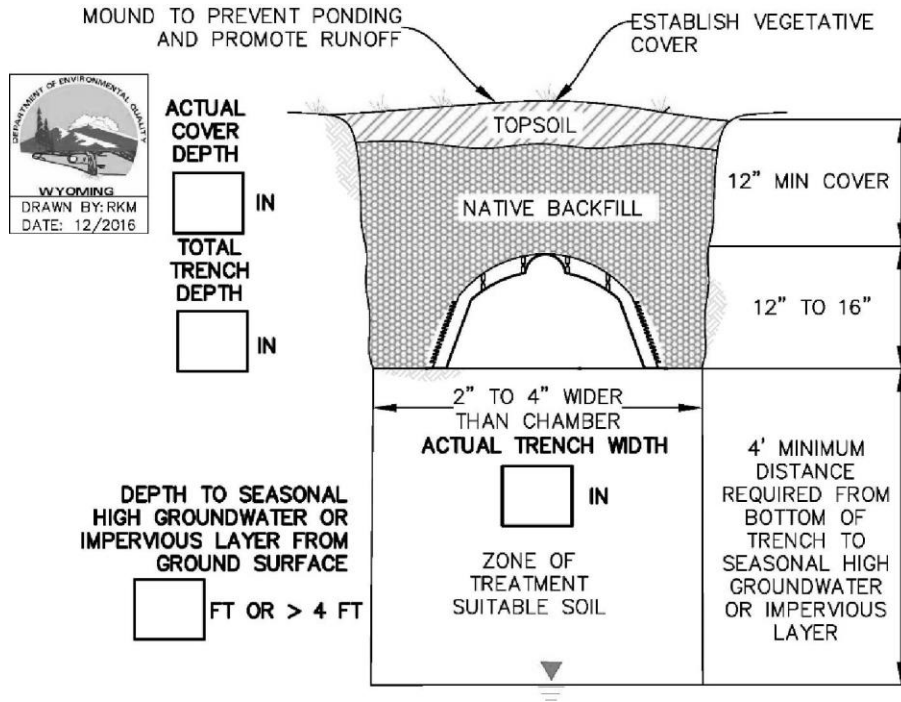





## Three, Five or Multi Trench Chambered Layout Design Sheet

<b>Notes:</b>	Please provide the actual dimensions in the boxes on the diagrams below. * The bottom of each trench shall be level throughout its length. * The maximum depth of each trench shall be 5 feet (60 inches).
---------------	--

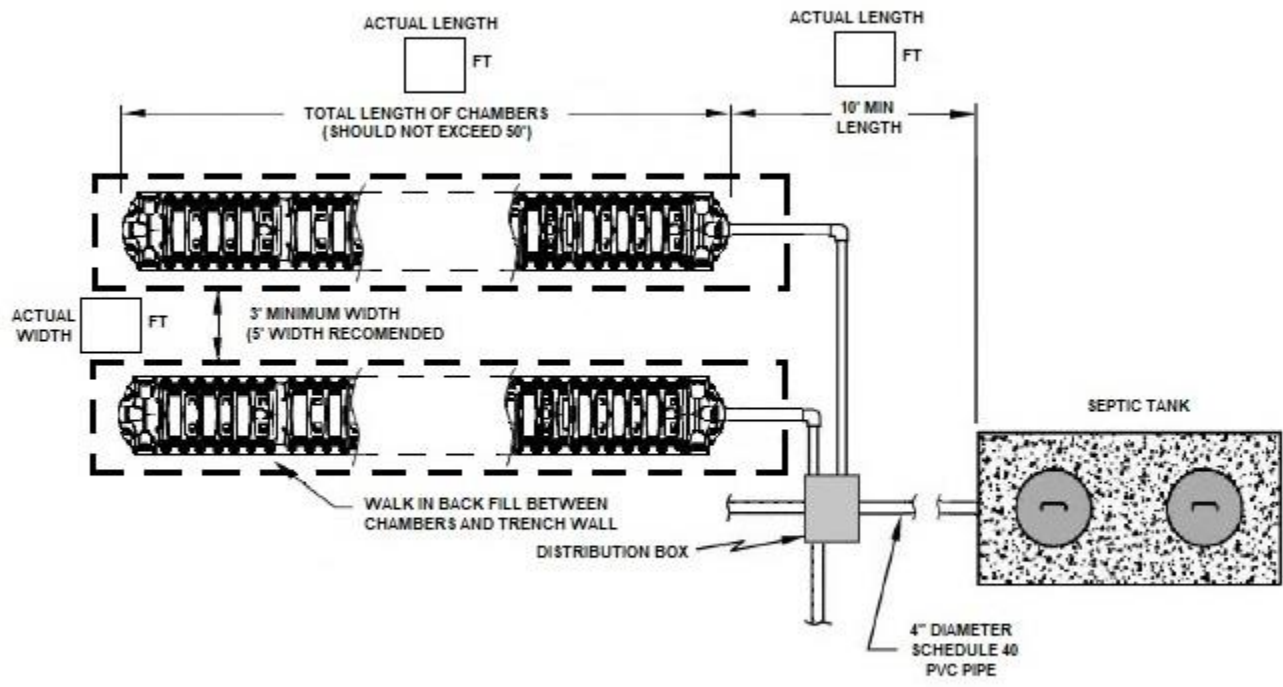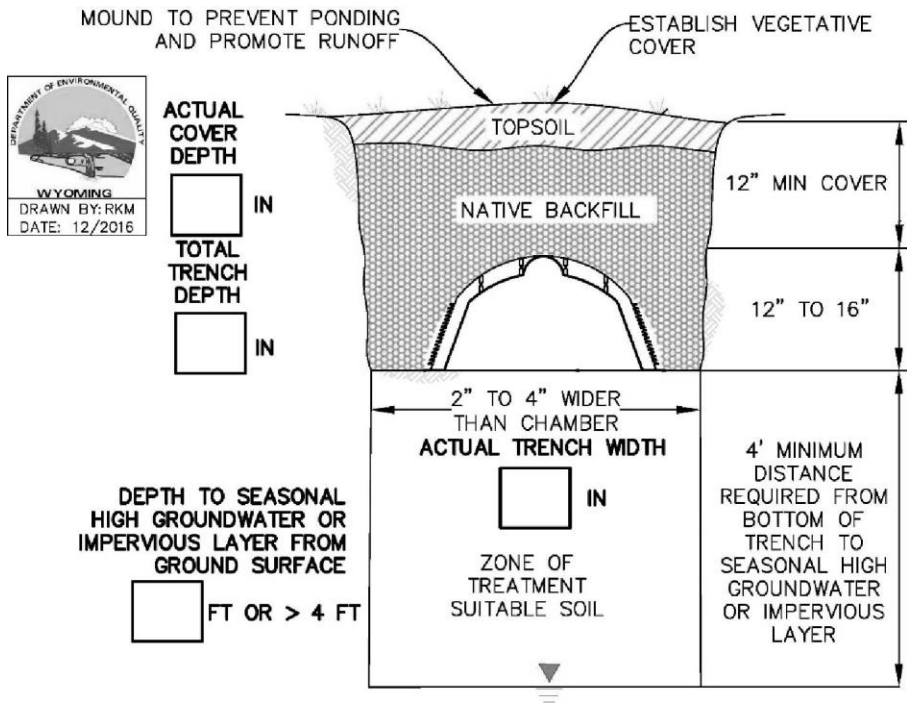

## Four Trench Chambered Design Sheet

**Notes:** Please provide the actual dimensions in the boxes on the diagrams below.  
 \* The bottom of each trench shall be level throughout its length.  
 \* The maximum depth of each trench shall be 5 feet (60 inches).

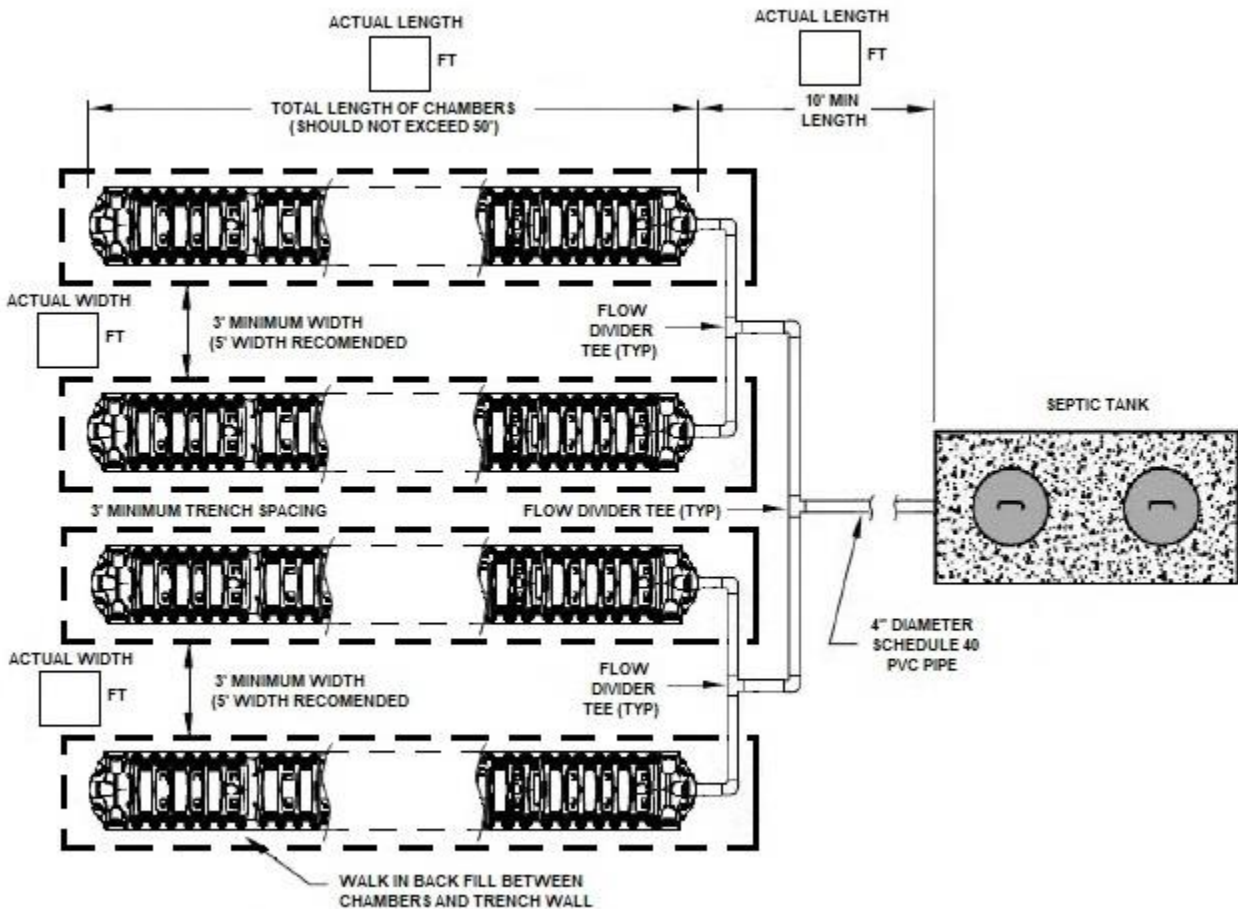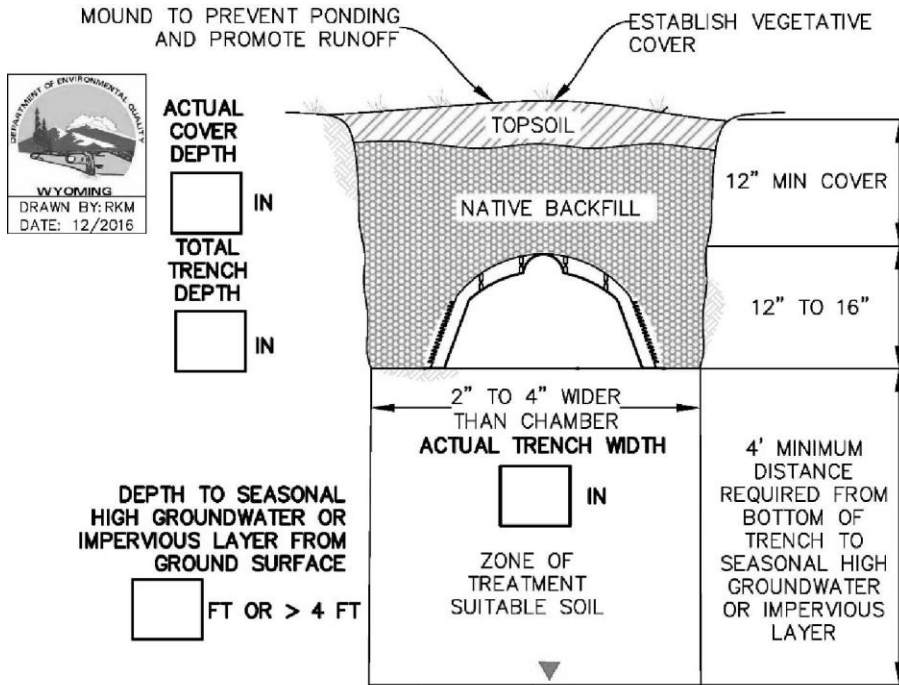

## Perforated Pipe Bed Layout Worksheet



<b>Design</b>		
Required Leachfield Area (Page 9, Box 3)	Box 1	
Total Excavated Depth (ft)		
Depth below pipe (ft)		
<b>Bed Layout</b>		
Bed Width (ft)	Box 2	
Bed Length (ft)	Box 3	
Bed Total Square feet	Box 4	
	$\frac{\text{Bed Width (Box 2)}}{\text{Bed Width (Box 2)}} * \frac{\text{Bed Length (Box 3)}}{\text{Bed Length (Box 3)}} = \frac{\text{Total Bed Area}}{\text{Total Bed Area}}$	
Is Box 4 greater than or equal to Box 1	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<input type="checkbox"/>	If No, adjust Bed Width (Box 2) and Bed Length (Box 3) until Box 4 is greater than Box 1	
<b>Perforated Pipe Bed Layout Design Sheet</b>		
<input type="checkbox"/>	If Yes, Complete the following layout design sheet on the next page by filling in the boxes with the actual dimensions and number of laterals for your perforated bed layout	Page 23
<b>Notes:</b>	<p>The bed location shall be relatively flat; no more than 1-foot slope from the highest to lowest point.                      The maximum depth of the bed shall be 5 feet (60 inches).                      Leachfield header piping shall not be perforated.                      A maximum of 100 feet of perforated pipe per lateral.                      A maximum of 6 feet on center pipe lateral spacing.                      A maximum of 25 feet bed width.</p>	



## Perforated Pipe Bed Layout Design Sheet

**Notes:**

- Please provide the actual dimensions in the boxes on the diagrams below.
- \* The bottom of the bed shall be level throughout its length.
- \* The maximum depth of the bed shall be 5 feet (60 inches).
- \* Leachfield header piping shall not be perforated.

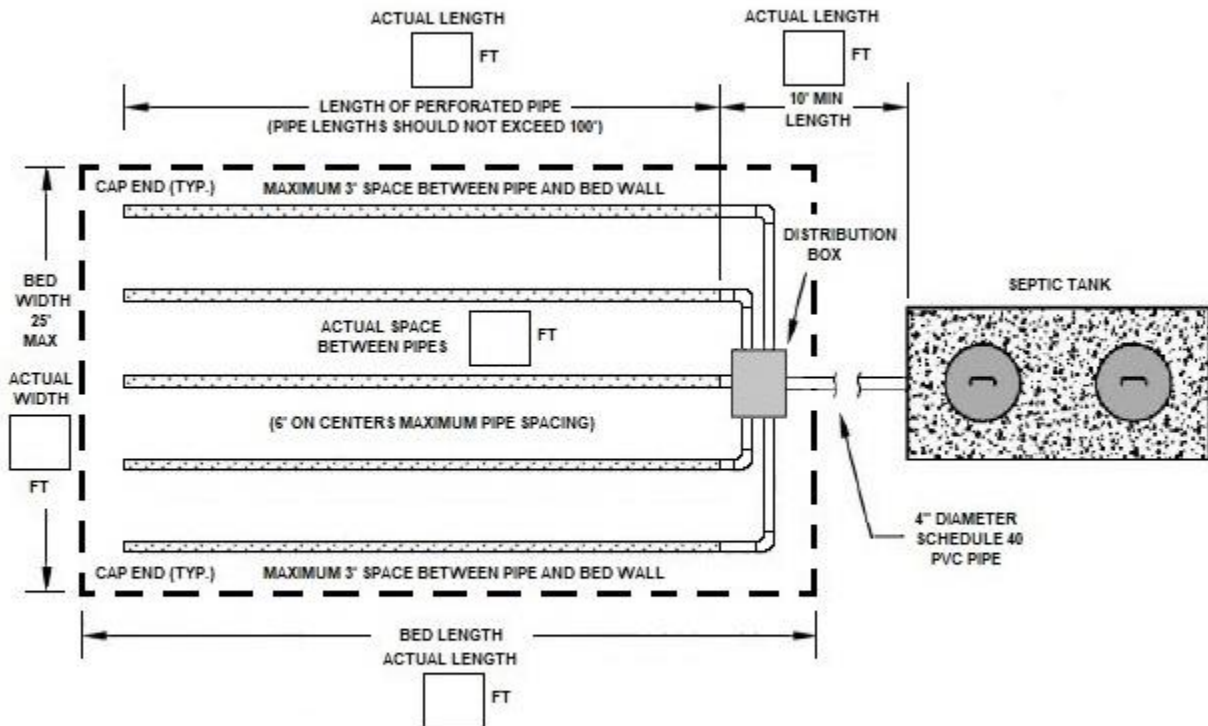
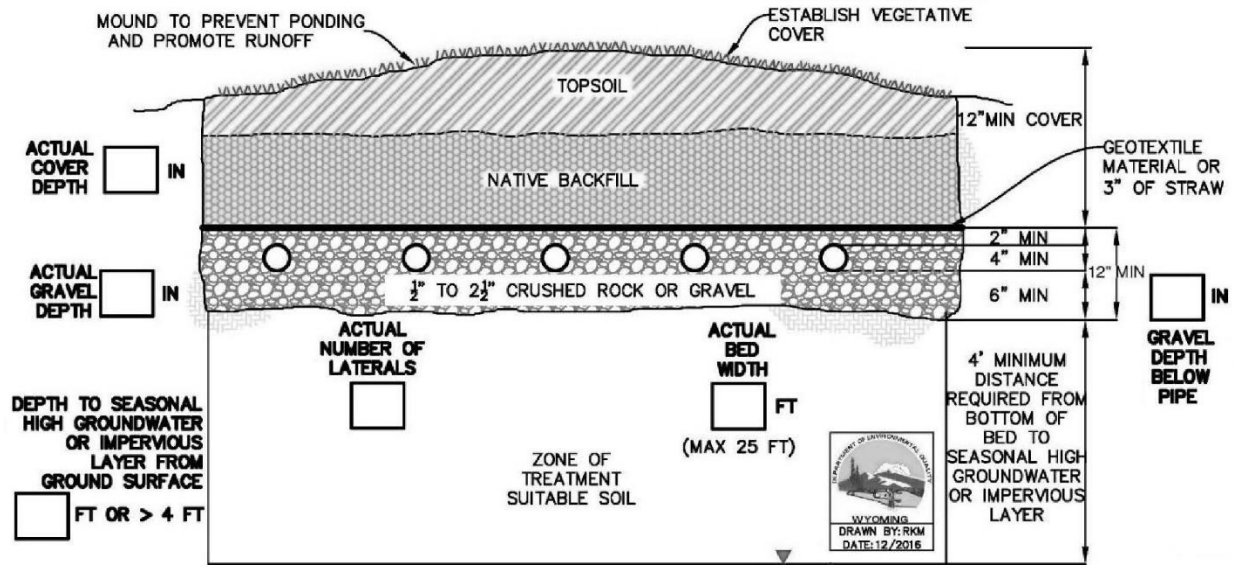


## Chambered Bed Layout Worksheet

<b>Chamber (See Table 1, Page 11)</b>			
Manufacturer			
Model			
Nominal Length (ft)			
Nominal Width (in)			
Nominal Height (in)			
Effective Length (ft)	Box 1		
<b>Design</b>			
Required Leachfield Area (Page 9, Box 3)	Box 2		
Equivalent Area Per Unit (See Table 1, Page 11)	Box 3		
Number of Chambers	Box 4		
	$\frac{\text{Required Leachfield Area (Box 2)}}{\text{Equivalent Area Per Unit (Box 3)}} = \frac{\text{Number of Chambers (Round Up)}}{\text{Number of Chambers (Round Up)}}$		
<b>Bed Layout</b>			
Total Chamber Length (ft)	Box 5		
	$\frac{\text{Number of Chambers (Box 4)}}{\text{Number of Chambers (Box 4)}} * \frac{\text{Effective Length (Box 1)}}{\text{Effective Length (Box 1)}} = \frac{\text{Total Chamber Length}}{\text{Total Chamber Length}}$		
Number of Chamber Rows to Use	<b>Total Chamber Length (ft) (from Box 5)</b>	<b>Minimum Number of Chamber Rows to Use</b>	Box 6
	<51 51-100 101-150 151-200 201-250 251-300	1 2 3* 4 5* 6	Number of Chamber Rows = _____  Length of Rows = _____  *A distribution box, or D-box, is required when an odd number of trenches is used.
<b>Chamber Bed Layout Design Sheet</b>			
Complete the following layout design sheet on the next page by filling in the boxes with the actual dimensions and number of laterals for your chambered bed layout.			Page 25
<b>Notes:</b>	The bed location shall be relatively flat; no more than 1-foot slope from the highest to lowest point. The maximum depth of the bed shall be 5 feet (60 inches). A minimum of 6 inch spacing between chambers. A maximum of 50 feet of chambers per row. A maximum of 25 feet bed width.		

## Chambered Bed Layout Design Sheet

**Notes:** Please provide the actual dimensions in the boxes on the diagrams below.  
 \* The bottom of the bed shall be level throughout its length.  
 \* The maximum depth of the bed shall be 5 feet (60 inches).

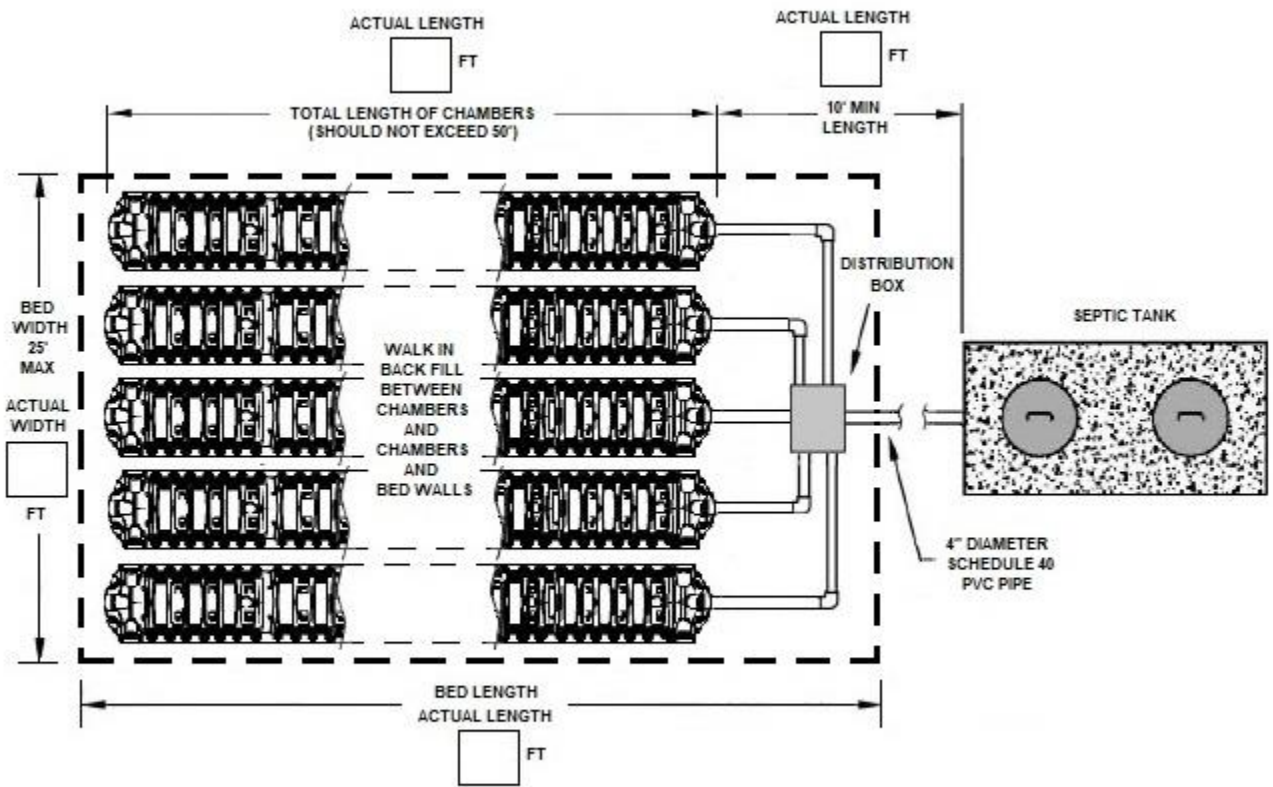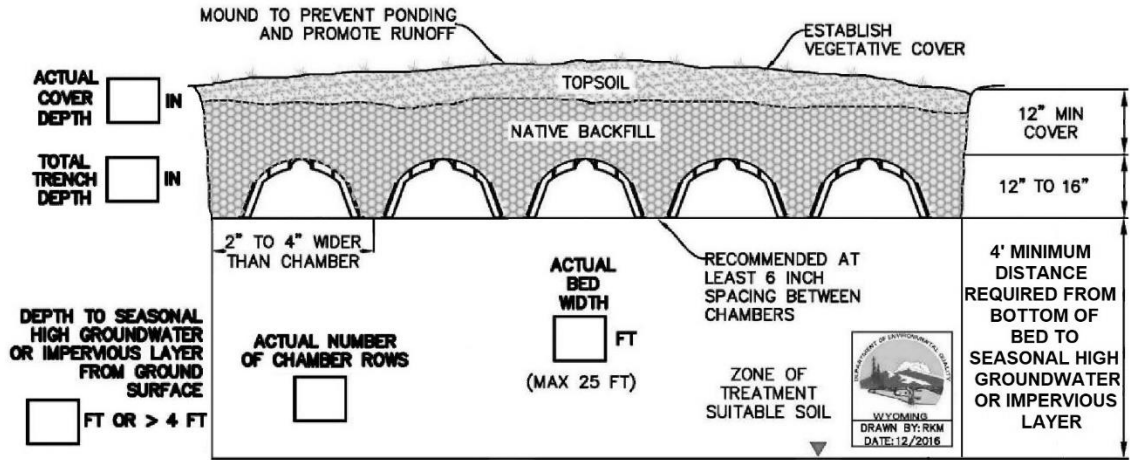

**Attachment 1. Table 2 Excerpted from the Crook County Small Wastewater Regulation.**

**Non-Residential Wastewater Design Flow Rates (Table 2 Excerpted from Crook County Small Wastewater Regulations)<sup>1</sup>**

<b>Facility</b>	<b>Unit</b>	<b>Flow (gallons/unit/day)</b>
Airports	person	4
Apartment	bedroom	120
Automobile Service Station	vehicle served	10
Bars	seat	20
Bathhouses and swimming pools	person	10
Campgrounds (w/ toilets only)	person	25
Campgrounds (w/shower facility)	person	45
Church	person	4
Country Club	member	25
Day School, Office Building, Retail Store, Warehouse (no showers)	person	15
Hospital	bed	250
Industrial Building (sanitary waste only)	employee	20
Laundry (self-service)	machine	450
Mobile Home	bedroom	see Table 1
Motel, Hotel, Resort	bedroom	140
Recreational Vehicle	each	100
Rest Home, Care Facility, Boarding School	bed	100
Restaurant	meal	10
Restaurant ( kitchen waste only)	meal	6
Theater	seat	3

<sup>1</sup>Values shown in the above table are the typical flow rates from *Wastewater Engineering Treatment and Reuse*, Metcalf and Eddy, 2003.

## Wyoming A-List of Previously Approved Septic Tanks

<b>City</b>	<b>Supplier</b>	<b>Size (gal)</b>	<b>Compartment</b>
<b>Casper</b>	A.J. Vollmar, WYO Septic Tanks	1000	Single
	AllTerra Construction, LLC	1000	Single
		1500	Single
	Forterra Pipe and Precast	1000	Single
1500		Single	
<b>Cheyenne</b>	Vaughn Concrete Products	1500	Single
		2000	Single
		1000	Two
		1250	Two
		1500	Two
		2000	Two
<b>Cody</b>	Cody Precast & Septic Service	1500	Single
		1000	Two
		1500	Two
<b>Evanston</b>	Ellingford Brothers, Inc.	1000	Two
<b>Etna-Thayne</b>	Precast Concrete Products	1000	Single
		1000	Two
		1500	Two
<b>Gillette</b>	Intermountain Construction & Materials	1250	Single
<b>Mills</b>	American Plumbing and Heating	1000	Single
<b>Pinedale</b>	Summit Precast	1000	Two
<b>Powell</b>	Big Horn Precast	1000	Two
		1250	Two
		2000	Two
<b>Riverton</b>	Wind River Ready Mix	1000	Single
		1000	Two
<b>Rock Springs</b>	Rock Springs Block Co.	1250	Single
		1550	Single
		1750	Single
<b>Sheridan</b>	Manor Precast and Materials (Skyline)	1000	Single
		1250	Single
		1500	Single
		1500	Two
<b>Torrington</b>	G & L Concrete, Inc.	1000	Single
<b>Wheatland</b>	Croell Redi-Mix (Model A)	1000	Single
<b>Worland</b>	PBR, Inc.	1000	Two
		1500	Two

**Other States A-List of Previously Approved Septic Tanks**

<b>State</b>	<b>City</b>	<b>Supplier</b>	<b>Size (gal)</b>	<b>Compartment</b>
<b>Colorado</b>	<b>Rifle</b>	Copeland Concrete	1250	Two
			2000	Two
			2500	Two
			3000	Two
	<b>Loveland</b>	Oldcastle Precast Concrete	1000	Two (Round)
			1250	Two
			1500	Two
			2000	Two
			2500	Two
			3000	Two
1250			Single	
2500			Single	
3000	Single			
<b>Indiana</b>	<b>Plymouth</b>	AK Industries, Inc.	1500	Two
<b>Iowa</b>	<b>Hospers</b>	Ace Roto-Mold, Den Hartog Industries	1250	Single
			1500	Single
			1000	Two
			1250	Two
			1500	Two
<b>Minnesota</b>	<b>St. Bonifacius</b>	Norwesco	1000	Single
			1250	Single
			1500	Single
			1000	Two
			1250	Two
			1500	Two
<b>Montana</b>	<b>Billings</b>	Billings Precast Enterprises	1000	Two
			1500	Two
	<b>Three Forks</b>	Kanta Products, Inc.	1500	Single
			1000	Two
			1500	Two
	<b>Billings</b>	Montana Terrazzo Company	1000	Two
			1100	Two
			1500	Two
			2000	Two

**Other States A-List of Previously Approved Septic Tanks**

<b>State</b>	<b>City</b>	<b>Supplier</b>	<b>Size (gal)</b>	<b>Compartment</b>
<b>Nebraska</b>	<b>Scottsbluff</b>	Panhandle Concrete Products, Inc.	1000	Two
			1250	Two
			1500	Two
			2000	Two
	<b>Lincoln</b>	Snyder Industries, Inc.	1000	Two
			1250	Two
			1500	Two
			1500	Single
<b>South Dakota</b>	<b>Newell</b>	Boom Concrete	1000	Single
			1500	Single
			1500	Two
	<b>Rapid City</b>	J & D Precast, Inc.	1000	Single
			1000	Two
			1500	Two
			2000	Two
			3350	Two
<b>Utah</b>	<b>Salt Lake City</b>	DURA-CRETE, Inc.	1000	Single
			1250	Single
			1500	Single
			1750	Single
			2500	Single
			1000	Two
	<b>Hyde Park</b>	Robertson Manufacturing	1500	Single
			2000	Single

## B-List of Previously Approved Septic Tanks

Use of the following tanks in Wyoming MAY be approved on an individual basis when justified by conditions.

State	City	Supplier	Size (gal)	Compartment
<b>Wyoming</b>	<b>Cody</b>	Cody Precast	1000	Two
	<b>Powell</b>	Big Horn Precast	1000	Two
			1500	Two
	<b>Riverton</b>	Wind River Ready Mix	1000	Two
<b>Colorado</b>	<b>Denver</b>	Rotonics Manufacturing, Inc.	1250	Two
	<b>Rifle</b>	Copeland Concrete, Inc.	1000	Two
			1250	Two
			1500	Two
<b>Connecticut</b>	<b>Old Saybrook</b>	Infiltrator Systems, Inc.	TW-1050	Two
			TW-1250	Two
			TW-1500	Two
			IM-1060	Two
			IM-1530	Two
<b>Indiana</b>	<b>Plymouth</b>	AK Industries, Inc.	1050	Two
			1500	Two
<b>Minnesota</b>	<b>St. Bonifacius</b>	Norwesco	1000	LP-Single
			1250	LP-Single
			1500	LP-Single
			1000	LP-Two
			1250	LP-Two
			1500	LP-Two
<b>Nebraska</b>	<b>Lincoln</b>	Snyder Industries, Inc.	1000	LP-Single
			1250	LP-Single
			1500	LP-Single
			1000	LP-Two
			1250	LP-Two
			1500	LP-Two
<b>New York</b>	<b>Syracuse</b>	Roth Global Plastics, Inc.	1060	Two
			1250	Two
			1500	Two
<b>Montana</b>	<b>Three Forks</b>	J & R Precast Concrete	“B” Model and “Cascade” Model vault toilets only	